


OPTION 1 - TITANBOND & SAM

GP TITANBOND TO BE CUT AND INSTALLED AROUND STEEL PLATE WITH SELF ADHESIVE MEMBRANE USED TO LAP AND TERMINATE AGAINST STEEL

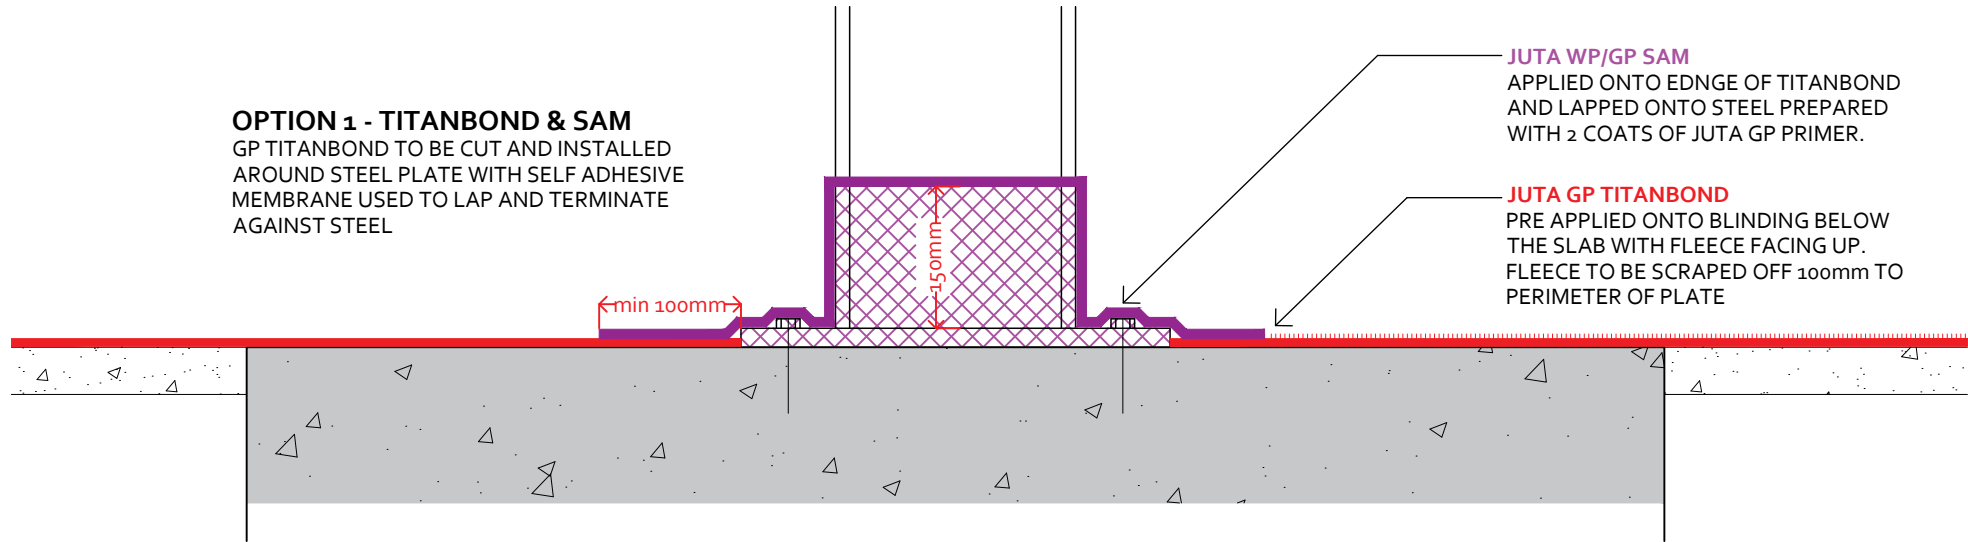

JUTA WP/GP SAM


APPLIED ONTO EDNGE OF TITANBOND AND LAPPED ONTO STEEL PREPARED WITH 2 COATS OF JUTA GP PRIMER.

JUTA GP TITANBOND

PRE APPLIED ONTO BLINDING BELOW THE SLAB WITH FLEECE FACING UP. FLEECE TO BE SCRAPPED OFF 100mm TO PERIMETER OF PLATE

OPTION 2 - TITANBOND & LIQUID GB

LIQUID GB PAINT APPLIED TO STEEL BASE & STANCHION EXTENDING A MIN 100mm ONTO FOUNDATION. GP TITANBOND LAPPED OVER AND SEALED USING DOUBLE SIDED TAPE

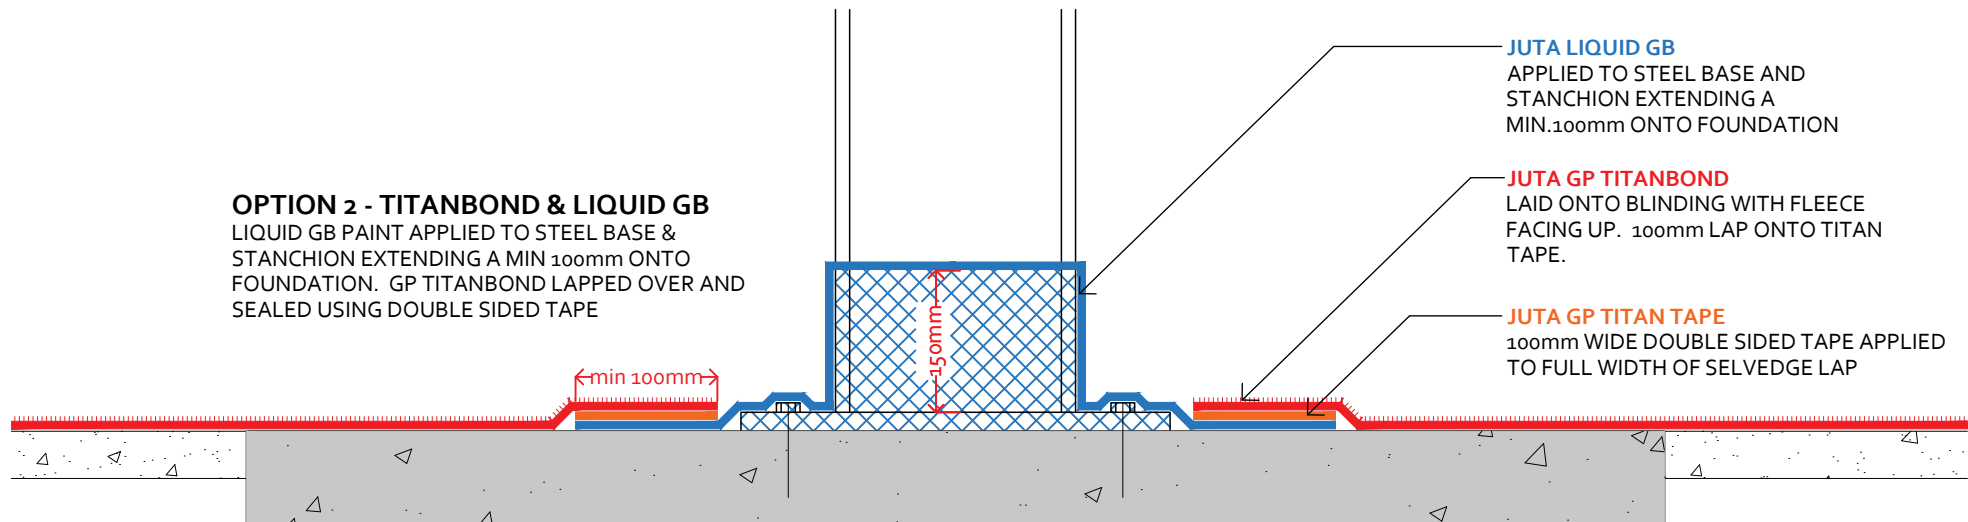

JUTA LIQUID GB

APPLIED TO STEEL BASE AND STANCHION EXTENDING A MIN.100mm ONTO FOUNDATION

JUTA GP TITANBOND

LAID ONTO BLINDING WITH FLEECE FACING UP. 100mm LAP ONTO TITAN TAPE.

JUTA GP TITAN TAPE

100mm WIDE DOUBLE SIDED TAPE APPLIED TO FULL WIDTH OF SELVEDGE LAP

CLIENT JUTA UK LTD

PROJECT GP® TITANBOND - Standard Details




NOTES

- Detail is generic to application so should not be used as a guide not a specific installation detail.
- GP®TITANBOND is a TYPE A Waterproofing membrane, in accordance with BS8102:2009, suitable for Grade 1, 2 and 3 Basement constructions.
- GP® TITANBOND is a proprietary gas and VOC resistant DPM, manufactured and certified to adhere to the requirements of BS8485: 2015+A1: 2019 and CIRIA C748: 2014 as a radon, carbon dioxide, methane and VOC barrier.
- Jointing and sealing using tapes is acceptable where anticipated design service life does not exceed 25 years.
- Jointing and sealing by hot air welding is recommended where the anticipated design service life is required to exceed 60 years.
- The use of butyl and bitumen based tapes in environments where VOC and Hydrocarbons are a perceived risk should be avoided. A thermal/welded joint system should be adopted.
- It should be noted that the suitability of the welded joint is defined by the joint integrity, as tested in accordance with CIRIA C735: 2014. This is most commonly tested by air lance integrity testing to ASTM D4437-08: 2013. If the joint passes this test it is deemed acceptable in the verification process.
- In all cases it is recommended the installation of gas barrier geomembranes is completed by a suitably qualified and accredited installer (NVQ L2/TWI/CSWIP or equivalent). Juta UK can offer advice as to the suitable/recommended installers.
- The gas protection system installation should be subject to third-party independent verification, in accordance with BS8485: 2015 +A1: 2019 and CIRIA C735: 2014.
- All design decisions made by others that might have an impact on the gas and waterproof design performance should be brought to the attention of the design team and Juta UK Ltd. Final decisions and/or any recommendations should be approved by the design team and Juta UK Ltd.
- Dimensions are not to be scaled from this drawing. All written measurements are to be checked on site by the contractor.
- All rights described in chapter IV of the copyright, design and patents act 1988 have been generally asserted.

DRAWING TITLE
JUTA GP® TITANBOND
STEEL STANCHION SEALING DETAILS

DRAWING NUMBER
JUTA.TB.035

DRAWN BY PD	CHECKED BY PF	SCALE Not to Scale	DATE Dec. 2020
----------------	------------------	-----------------------	-------------------



MELTON GROVE WORKS
BLACKPOOL ROAD
LYTHAM
FY8 5PL

Tel: 01772 754177