




GP-SAM.002  
GP-SAM.003

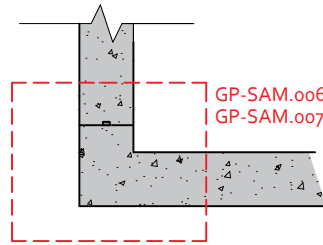


GP-SAM.006  
GP-SAM.007

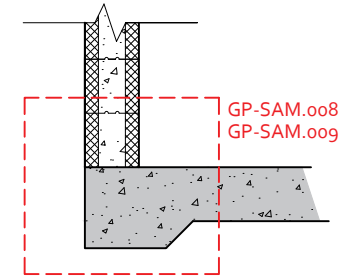


GP-SAM.008  
GP-SAM.009

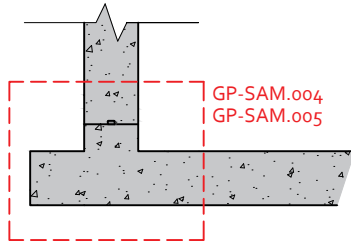


GP-SAM.004  
GP-SAM.005

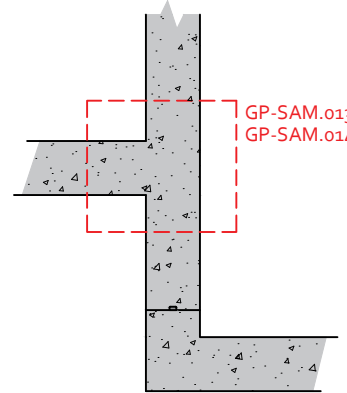


GP-SAM.013  
GP-SAM.014

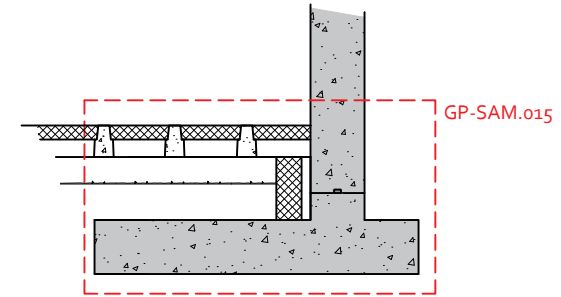


GP-SAM.015

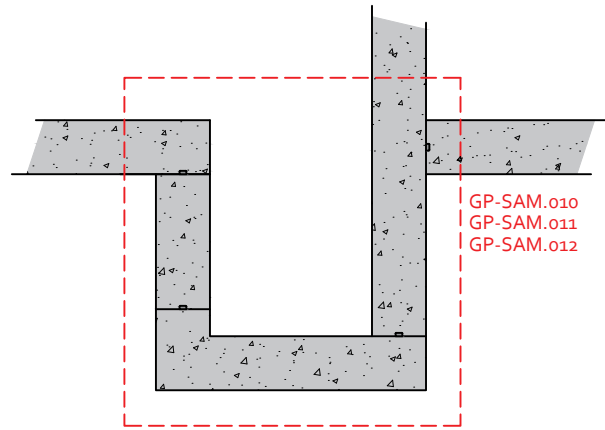

GP-SAM.010  
GP-SAM.011  
GP-SAM.012

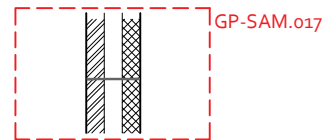

GP-SAM.017

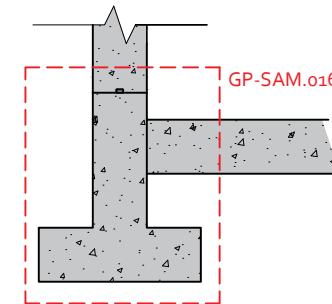

GP-SAM.016

CLIENT  
JUTA UK LTD

PROJECT  
JUTA GP® Titantank Typical Details




NOTES

- Detail is generic to application so should be used as a guide not a specific installation detail.
- GP® TITANTANK is a proprietary self adhesive gas and VOC resistant DPM, manufactured and certified to adhere to the requirements of BS8485: 2015+A1: 2019 and CIRIA C748: 2014 as a radon, carbon dioxide, methane and VOC barrier.
- GP® TITANFLEX provides radon protection, in accordance with Approved Doc C (UK) and Technical Guidance Document C (Ireland).
- Jointing and sealing using tapes is acceptable where anticipated design service life does not exceed 25 years.
- Jointing and sealing by hot air welding is recommended where the anticipated design service life is required to exceed 60 years.
- The use of butyl and bitumen based tapes in environments where VOC and Hydrocarbons are a perceived risk should be avoided. A thermal/welded joint system should be adopted.
- It should be noted that the suitability of the welded joint is defined by the joint integrity, as tested in accordance with CIRIA C735: 2014. This is most commonly tested by air lance integrity testing to ASTM D4437-08: 2013. If the joint passes this test it is deemed acceptable in the verification process.
- In all cases it is recommended the installation of gas barrier geomembranes is completed by a suitably qualified and accredited installer (NVQ L2/TWI/CSWIP or equivalent). JUTA UK can offer advice as to the suitable/recommended installers.
- The gas protection system installation should be subject to third-party independent verification, in accordance with BS8485: 2015 +A1: 2019 and CIRIA C735: 2014.
- All design decisions made by others that might have an impact on the gas and waterproof design performance should be brought to the attention of the design team and JUTA UK Ltd. Final decisions and/or any recommendations should be approved by the design team and JUTA UK Ltd.
- Dimensions are not to be scaled from this drawing. All written measurements are to be checked on site by the contractor.
- All rights described in chapter IV of the copyright, design and patents act 1988 have been generally asserted.

DRAWING TITLE  
**JUTA GP® TITANTANK**  
CAVITY WALL - DPC TERMINATION DETAIL

DRAWING NUMBER  
JUTA.GP-TT.001

DRAWN BY PD	CHECKED BY PF	SCALE Not to Scale	DATE Mar. 2020
----------------	------------------	-----------------------	-------------------



MELTON GROVE WORKS  
BLACKPOOL ROAD  
LYTHAM  
FY8 5PL  
Tel: 01772 754177